



Notes:

- 1) All Cabling supplied by customer except for cabling from sensor bar to Junction Box
- 2) Systems configured for 110VAC cannot be used with 220VAC w/o modifications.
- 3) All external wiring to be done per local electrical codes.
- 4) Customer Requirements Prior to U.S. Automation Technician arrives unless other previous arrangements have been made:
 - All web detection bars and associated junction boxes installed on the press
 - Master Control Unit installed in an enclosure
 - Main Touchscreen and Optional Remote Screen installed in a console or enclosure
 - 10% and 20% speed signal(s) brought to Master Control Unit for each pressline
 - E-Stop Loop(s) (Press Stop Request) brought back to Master Control Unit
 - Pull all cables between various electronics components, i.e. j-boxes, master control unit, and touchscreen (note: U.S. Automation will complete termination of cables)
 - Control wiring for severers brought back to Master Control Unit if applicable
 - Provide clean system power on dedicated circuit to WebMax Master Control CPU Unit

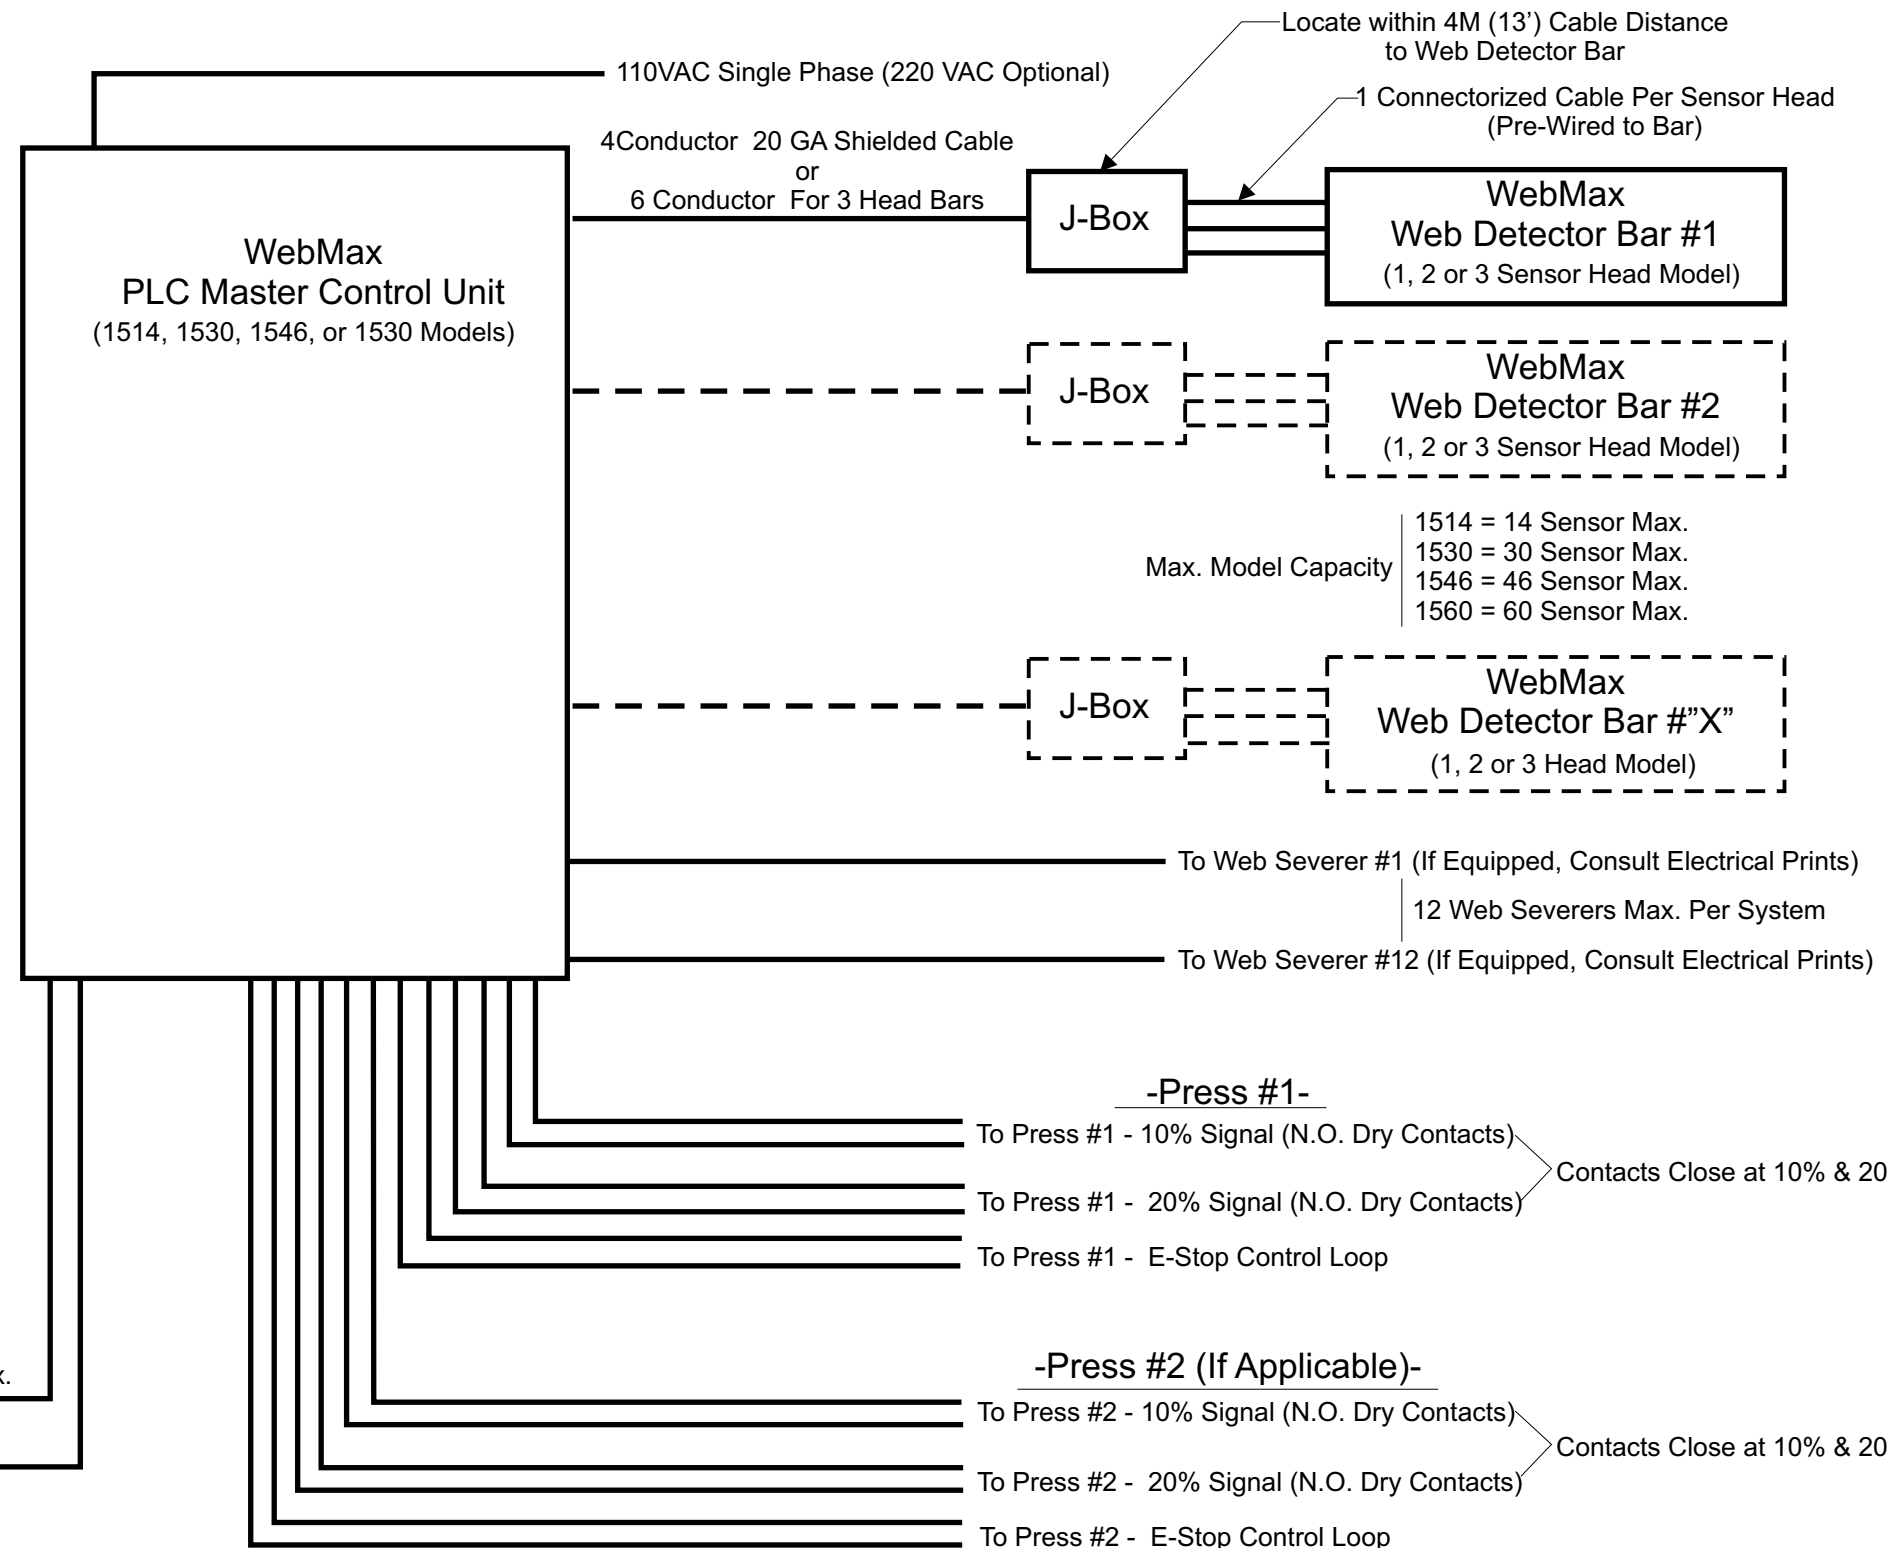

Max. Model Capacity

- 1514 = 14 Sensor Max.
- 1530 = 30 Sensor Max.
- 1546 = 46 Sensor Max.
- 1560 = 60 Sensor Max.

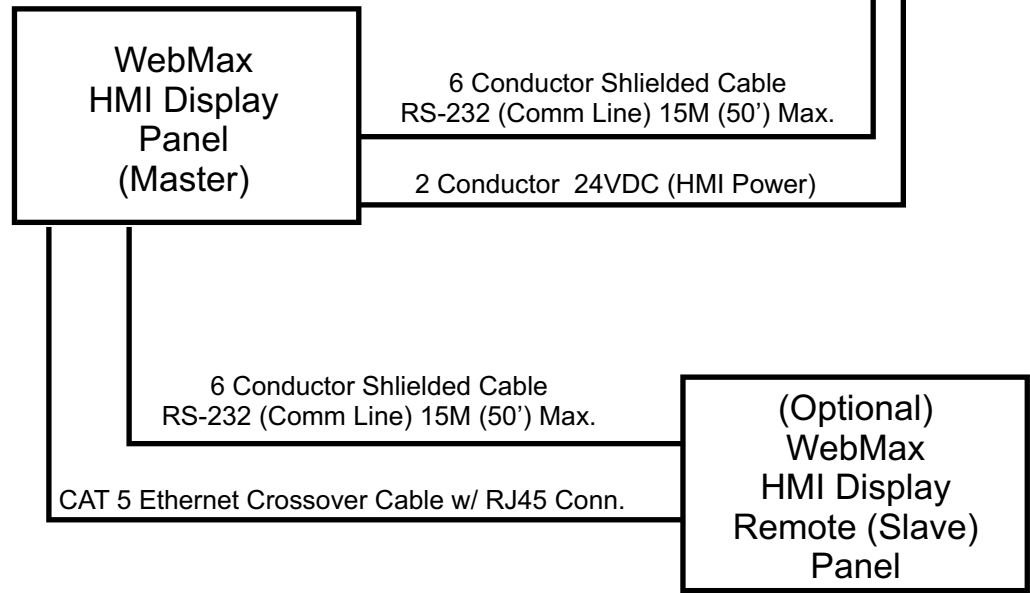

Rev.	Description

THIS DOCUMENT IS PROPRIETARY PROPERTY OF U.S. AUTOMATION, INC. THIS DOCUMENT IS TO BE USED ONLY FOR THE PURPOSE FOR WHICH IT HAS BEEN LOANED AND IT IS TO BE RETURNED IMMEDIATELY AFTER USAGE. THIS DOCUMENT SHALL NOT BE COPIED OR REPRODUCED WITHOUT PERMISSION FROM U.S. AUTOMATION INC.

U.S. Automation, Inc.
 21360 Gateway Ct.
 Brookfield, WI 53045
 USA

Project: Install Prints		Drawing No: 12862-B	
Drawn By: RCH 11-Nov-07		Job No:	Rev Level -
Description: Cable Diagram WebMax Web Detection System			Sheet: 1 of 2:

All web detection bars and associated junction boxes installed on the press

- Master Control Unit installed in an enclosure
- Main Touchscreen and Optional Remote Screen installed in a console or enclosure
- 10% and 20% speed signal(s) brought to Master Control Unit for each pressline
- E-Stop Loop(s) (Press Stop Request) brought back to Master Control Unit
- Pull all cables between various electronics components, i.e. j-boxes, master control unit, and touchscreen (note: U.S. Automation will complete termination of cables)
- Control wiring for severers brought back to Master Control Unit if applicable
- Provide clean system power on dedicated circuit to WebMax Master Control CPU Unit

Rev.	Description
<p>THIS DOCUMENT IS PROPRIETARY PROPERTY OF U.S. AUTOMATION, INC. THIS DOCUMENT IS TO BE USED ONLY FOR THE PURPOSE FOR WHICH IT HAS BEEN LOANED AND IT IS TO BE RETURNED IMMEDIATELY AFTER USAGE. THIS DOCUMENT SHALL NOT BE COPIED OR REPRODUCED WITHOUT PERMISSION FROM U.S. AUTOMATION INC.</p>	



21360 Gateway Ct.
 Brookfield, WI 53045
 USA

Project: Install Prints	Drawing No: 12862-B	
Drawn By: RCH 11-Nov-07	Job No:	Rev Level -
Description: Cable Diagram WebMax Web Detection System		Sheet: 1 of 2: